




## SONDALOOP / PS2

Wiring diagram for Sondaloop Ultrasonic Level Transmitter used with Type PS2 power supply, To be read in conjunction with Sondaloop and PS2 Installation and Setting Up Instructions

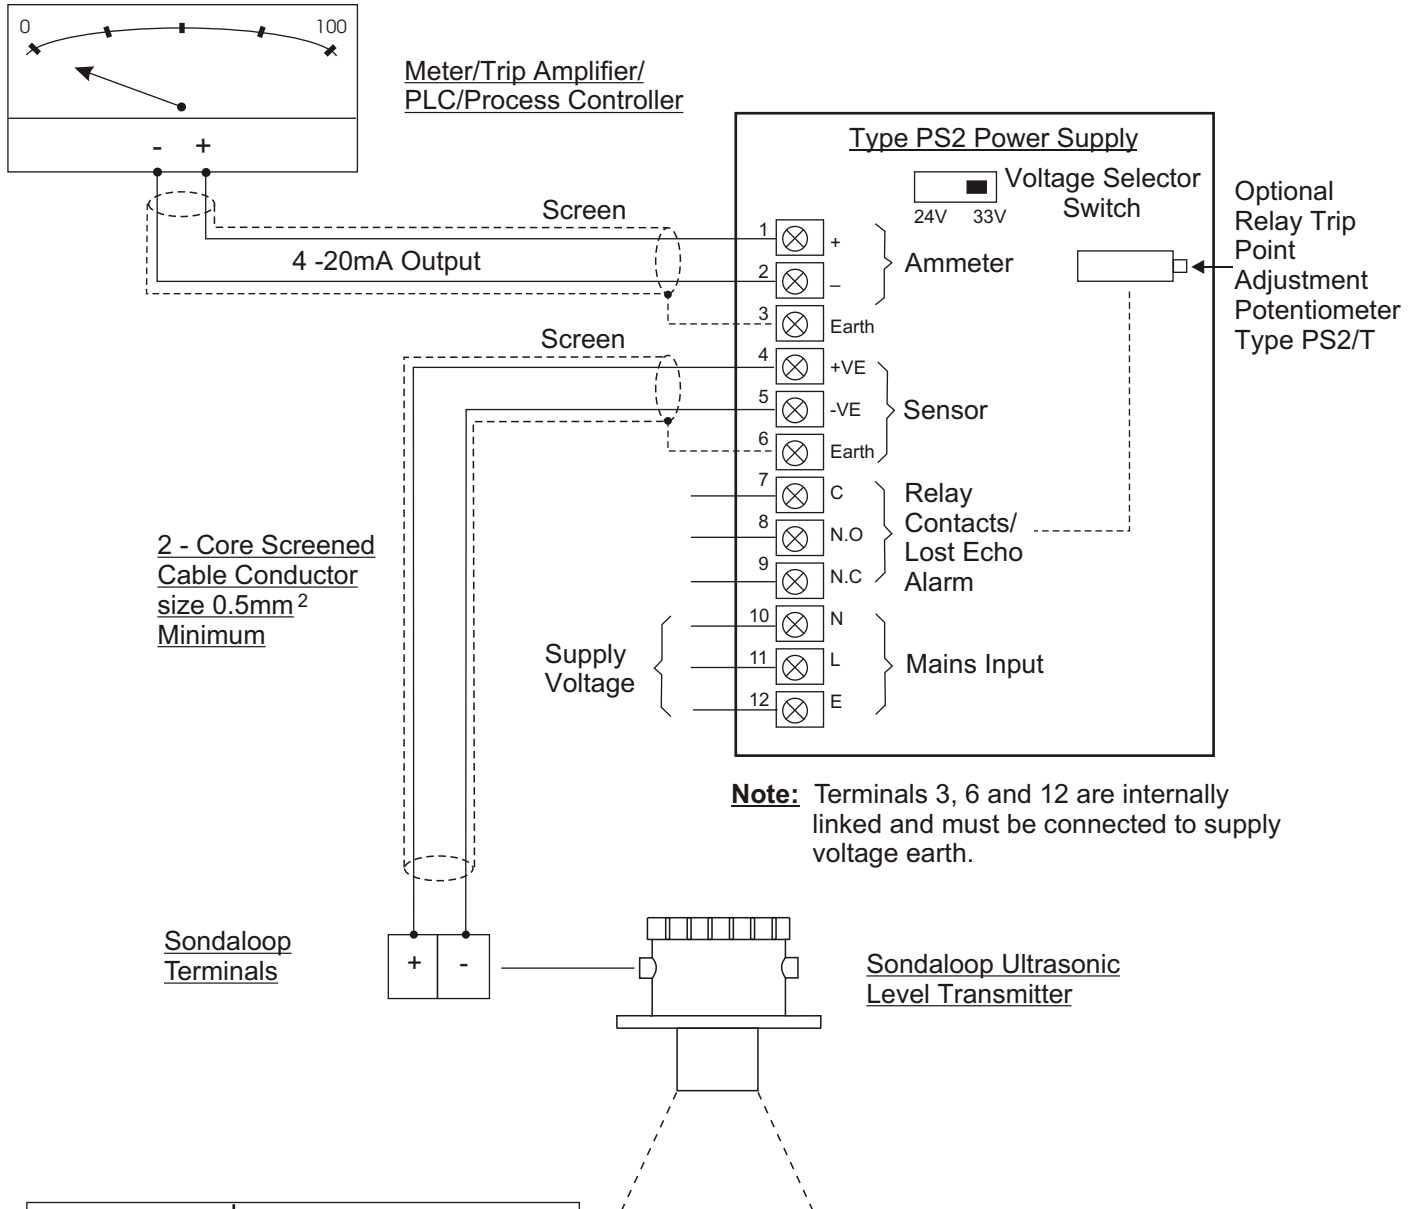

PS2 Voltage	Maximum Ammeter (4-20mA) Output Resistance
24V DC	250 OHMS
33V DC	650 OHMS

This product has been designed and complies to the relevant standards as listed in its certificate of conformity. The installer/user must ensure system compliance Because of continuing development we reserve the right to change the specification without notice

### HAWKER ELECTRONICS LTD

57, The Avenue,  
Rubery Industrial Estate,  
Birmingham, B45 9AL, England  
Telephone :+44(0)121-453-8911 Fax: +44(0)121-453-3777  
E.mail: info@hawker-electronics.co.uk



FM 10000



W D 54  
B.D. D694.cdr  
Issue B  
Feb 02