




Signal Conditioner Type 990

Application Wiring Diagram for Pressure Transducer Type 1830 to be read in conjunction with Type 990 Installation and Setting up Instructions

Red (+ VE Supply)
White (-VE Supply)
Yellow (+VE Output)
Blue (-VE Output)

Note
Connect Screen Wire to Earth at Signal Conditioner ONLY

Type TSD4S Transducer Cable 4-Core Screened & Vented.
Note Vent Tube must be allowed to Vent to Atmosphere

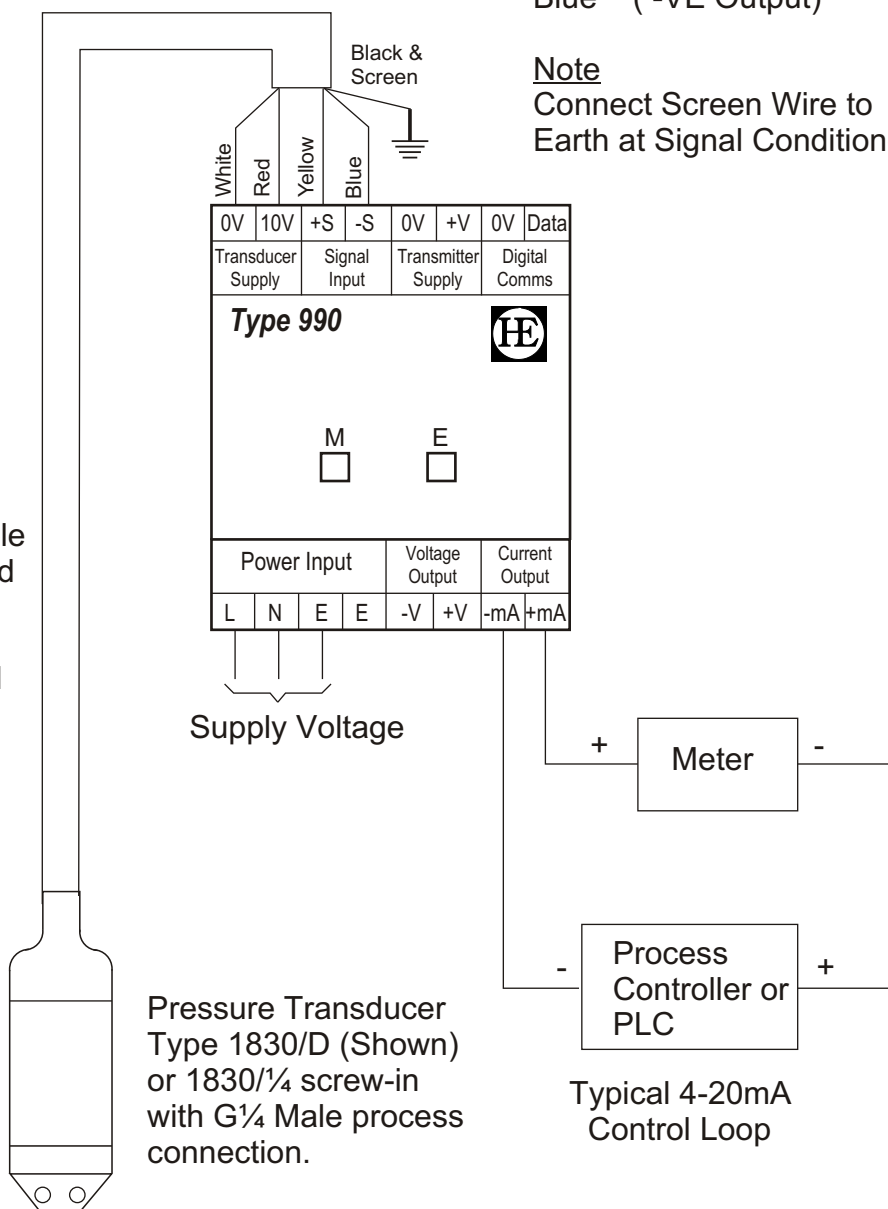

Pressure Transducer Type 1830/D (Shown) or 1830/1/4 screw-in with G1/4 Male process connection.

Typical 4-20mA Control Loop

This product has been designed and complies to the relevant standards as listed in its certificate of conformity. The installer/user must ensure system compliance
Because of continuing development we reserve the right to change the specification without notice

HAWKER ELECTRONICS LTD

57, The Avenue,
Rubery Industrial Estate,
Birmingham, B45 9AL, England
Telephone :+44(0)121-453-8911 Fax: +44(0)121-453-3777
E.mail: info@hawker-electronics.co.uk



FM 10000



W D 67
Issue A
Nov 04
D889.cdr